


SERVICE MATERIALS DESCRIPTION AND PARTS/MODEL NUMBERS

	1" METER	1-1/2" METER	2" METER
1	METER BOX	B-36 BOX W/G-709P LID AND PW/TRPL PLUG (OR 1.5" BOX+LID)	B-36 BOX W/G-709P LID AND PW/TRPL PLUG
2	ANGLE METER VALVE	1" - FORD BA63-444W-NL 1-1/2" - FORD BA43-666W-NL	1" - FORD BA43-666W-NL 1-1/2" - FORD BA43-666W-NL
3	SERVICE LINE (SIZE AS DIRECTED BY SJWD)	1" POLYETHYLENE TUBE, IPS 1-1/2" POLYETHYLENE TUBE, CIS	1-1/2" POLYETHYLENE TUBE, CIS 2" POLYETHYLENE TUBE, CIS
4	CORP. STOP	1" - FORD FB1101-4-NL 1-1/2" - FORD FB1100-6-NL	FORD FB1100-6-NL
5	90 DEG. ELBOW (REQUIRED)	1" - FORD L66-44-NL 1-1/2" - FORD L44-66-NL	FORD L44-66-NL
6	INSERT (STIFFENER, USE AT EACH) POLY CONNECTION, SEE SHT. 6)	1" - FORD 53-72 1-1/2" - FORD 54	FORD 54
7	SERVICE SADDLE (FOR ALL SIZES)	DIP, ACP, & STL - JONES 979 C-900 PVC - JONES 996	DIP - JONES 979 C-900 - JONES 996 OR EQUIV.
8	LOCATING WIRE	10 GA COPPER (INSULATED)	10 GA COPPER (INSULATED)
9	CONG. OR BRICK BLOCKING	2" X 4" (LENGTH AS REQ'D)	2" X 4" (LENGTH AS REQ'D)

NOTES:

- ALL MATERIALS SHALL BE 'LEAD FREE' PER CA STATE REQUIREMENTS.
- BACKFLOW PREVENTION DEVICES SHALL BE RPP-TYPE UNLESS OTHERWISE APPROVED BY SJWD ENGINEERING (WILKINS 975 XL2, OR FEBCD LF85Y). DDCD-TYPE MAY BE ALLOWED ON A SPECIAL CASE BASIS WITH SJWD ENGINEERING APPROVAL (WILKINS 350XL, FEBCD LF850).
- PROJECTS WITHIN SD. PLACER FIRE DISTRICT (SPFD) MAY BE GRANTED A SJWD WAIVER FROM THE BACKFLOW DEVICE REQUIREMENT PROVIDED A MODIFIED PASSIVE PURGE SYSTEM IS INSTALLED AND SJWD RECEIVES A SPFD INSP. CERT.
- COLD WEATHER INSULATED COVERS SHALL BE PROVIDED BY OWNER FOR ALL BACKFLOW DEVICES.
- SECURITY CAGES, FAUX ROCK COVERS, OR OTHER PROTECTION METHODS ARE THE OWNER'S RESPONSIBILITY.
- INSTALLATIONS REQUIRING A DOMESTIC METER LARGER THAN 1-IN SHALL BE PRE-APPROVED BY SJWD.
- SERVICE/BOX/METER SIZE, MANUFACTURER, TYPE AND MODEL TO BE DETERMINED AND APPROVED BY SJWD ENGINEER.
- PROVIDE DOMESTIC, IRRIGATION AND FIRE DEMAND CALCULATIONS FOR SJWD REVIEW FOR ALL PROJECTS.
- BOLLARDS MAY BE REQUIRED TO PROTECT BACKFLOW DEVICE IN TRAFFIC HAZARDOUS AREAS.
- BACKFLOW PREVENTION DEVICES SHALL BE TESTED ANNUALLY BY AN SJWD APPROVED, STATE CERTIFIED TESTER.
- PROPERTY OWNER SHALL BE RESPONSIBLE FOR ALL BACKFLOW DEVICE MAINTENANCE, REPAIRS AND REPLACEMENT.
- CONNECTIONS WITH UNSITE BOOSTER PUMPS SHALL BE APPROVED BY SJWD AND SHALL INCORPORATE A PRESSURE SUSTAINING CONTROL VALVE OR DEVICE TO ENSURE THE PUBLIC WATER SUPPLY DOES NOT DROP BELOW 20 PSI.
- SUBMIT PUMP SYSTEM DESIGN TO SJWD ENGINEER FOR PRE-APPROVAL BEFORE INSTALLATION.

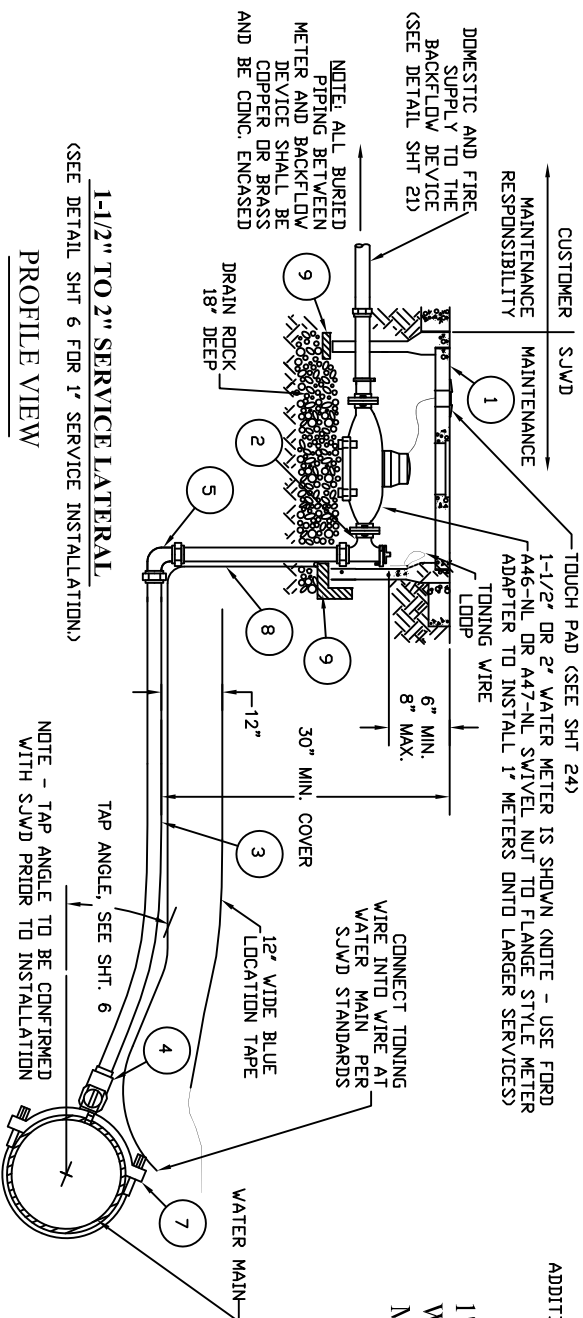

NOTE - TAP ANGLE TO BE CONFIRMED WITH SJWD PRIOR TO INSTALLATION

1-1/2" TO 2" SERVICE LATERAL
(SEE DETAIL SHT 6 FOR 1" SERVICE INSTALLATION)

PROFILE VIEW

1", 1-1/2" & 2" RESIDENTIAL FIRE SERVICE INSTALLATION

SAN JUAN WATER DISTRICT

NO	DATE	REVISIONS	APP	BY




NOTE - THE BACKFLOW DEVICE AND ALL FITTINGS, ETC. SHALL BE 'LEAD FREE' TYPE.

MAINTENANCE ISOLATION VALVE (TYPICAL ON BOTH SIDES OF BACKFLOW DEVICE)

NOTE - REFERENCE SHT 21 FOR INFO ON CONG. PAD AND BACKFLOW DEVICE INSTALLATION

WHEN REQUIRED BY SJWD BACKFILL PRIVATE FIRE SERVICE LINE FROM METER SPUD TO BACKFLOW USING CIP OR CONCRETE PER FIELD DIRECTION OF SJWD INSPECTOR

WATER METER AND METER BOX (SEE STD DETAIL SHEETS 6, 7, 18 AND 19 FOR ADDITIONAL INFO)

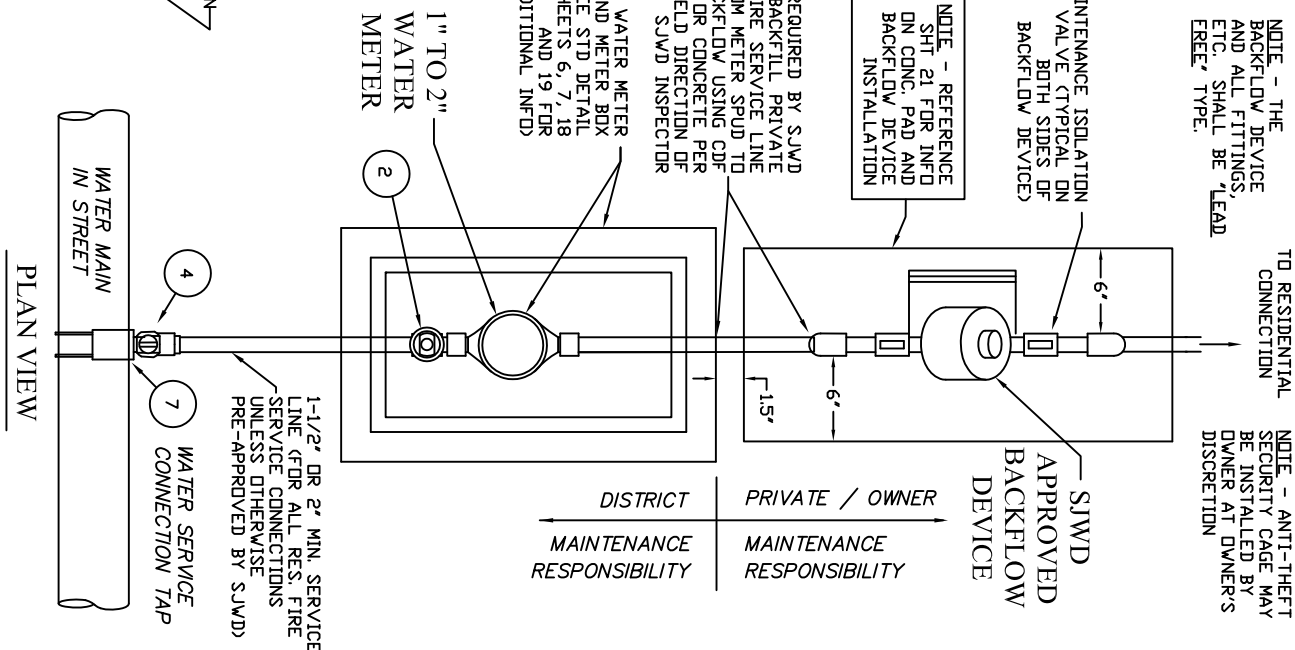

1-1/2" OR 2" MIN. SERVICE LINE (FOR ALL RES. FIRE SERVICE CONNECTIONS UNLESS OTHERWISE PRE-APPROVED BY SJWD)

WATER MAIN IN STREET

WATER SERVICE CONNECTION TAP

PLAN VIEW

APPROVED

SCALE:	PRINT DATE:	DETAIL NO:
NTS	06/22/16	SHT 4 OF 27